

AprilAire

Zone Control

SUBMITTAL SHEET

Model 8811

Protocol Adapter

Project: _____

Dealer: _____

Architect: _____


Engineer: _____

Contractor: _____

Location: _____

Suppliers: _____

Date: _____

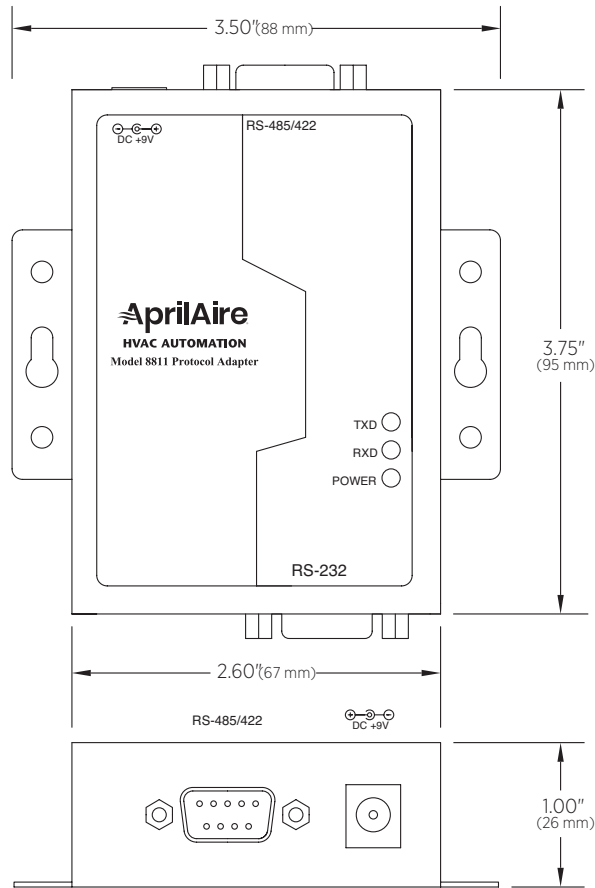

NOTES

Converts RS-485 to RS-232, allows computer interface to thermostats

Required for system communications troubleshooting

System operation LED indicators

Provided with: transformer, cable and breakout connector

The submittal is intended to show general, overall product dimensions and provide guidance for installation clearance. Drawings are not to scale. Ensure submittals are current. AprilAire reserves the right to make product changes without notification or obligation.